

11/19/2010
 TACO, INC.
 TACO Pump Selection, version 7.2

Engineer: MJD Engineers, Inc.
 Representative: A. Waldrop Company, Inc.
 Salesman: J. W. Waldrop

INPUT PARAMETERS

Single Pump System
 Fluid Type: Water @ 60 F
 Motor RPM: 1760
 Motor Type: 3/4 HP
 Motor Voltage: 208 V
 System Flow Rate: 655 (GPM)
 Head: 73 (ft)

SELECTION RESULTS



Pump 1
 Imp. Dia. 9.125
 Motor 3/4 HP
 Motor Voltage 208 V

Submittal Data Information
 FI Series Pumps
 MODEL 5011
 1760 RPM

CONTRACTOR:
 REP: A. Waldrop Company, Inc.

NO.	IMP. DIA.	FLOW (GPM)	HEAD (FT)	POWER (HP)	ELEC. CHARS
1	9.125	655	73	3.5	4000000



VALVE SHALL STAY OPEN DURING NORMAL OPERATION

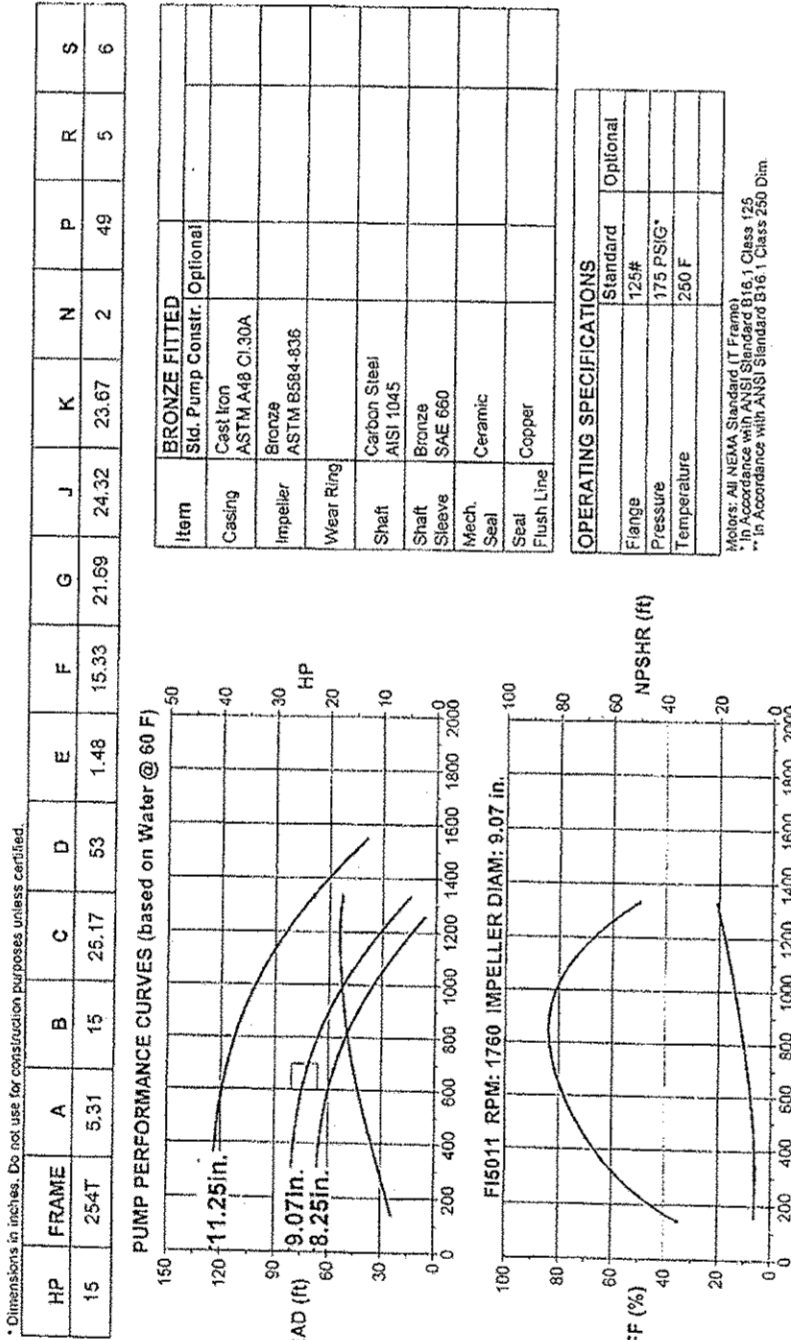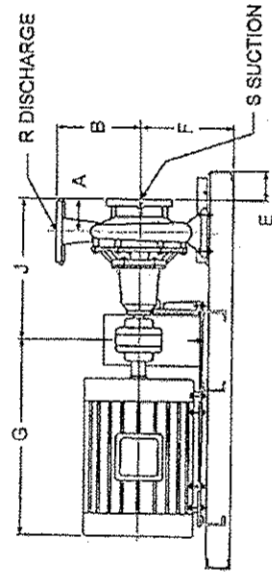

Do it once. Do it right.
 TACO, INC., 11400 Corporate Blvd., Houston, TX 77037
 Telephone: (281) 440-2000 FAX: (281) 440-2000
 TACO (Canada), Ltd., 9100 Dixon Drive, Mississauga, Ontario L4T 1B3, Telephone: (905) 884-4402 FAX: (905) 884-4428

1 CHILLED WATER PUMP GENERAL DATA
 NOT TO SCALE

2 CHILLED WATER PUMP DIMENSIONAL DATA
 NOT TO SCALE

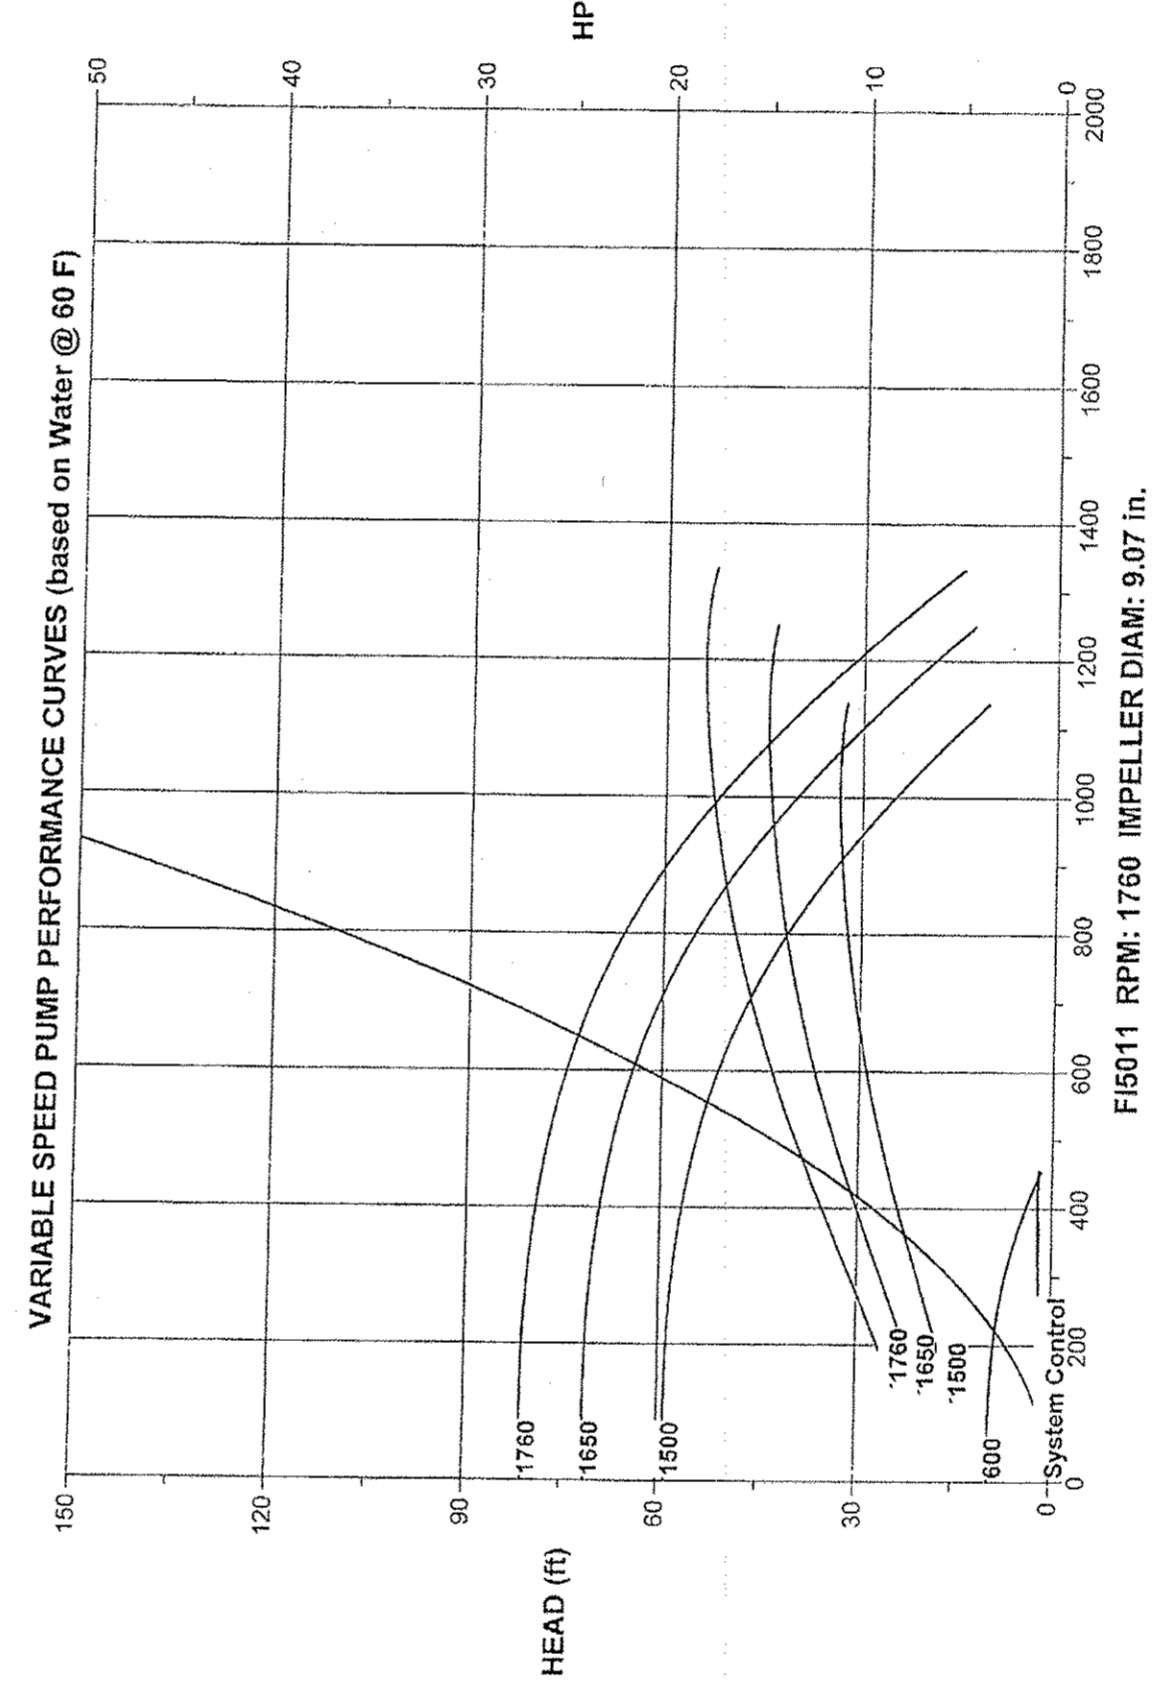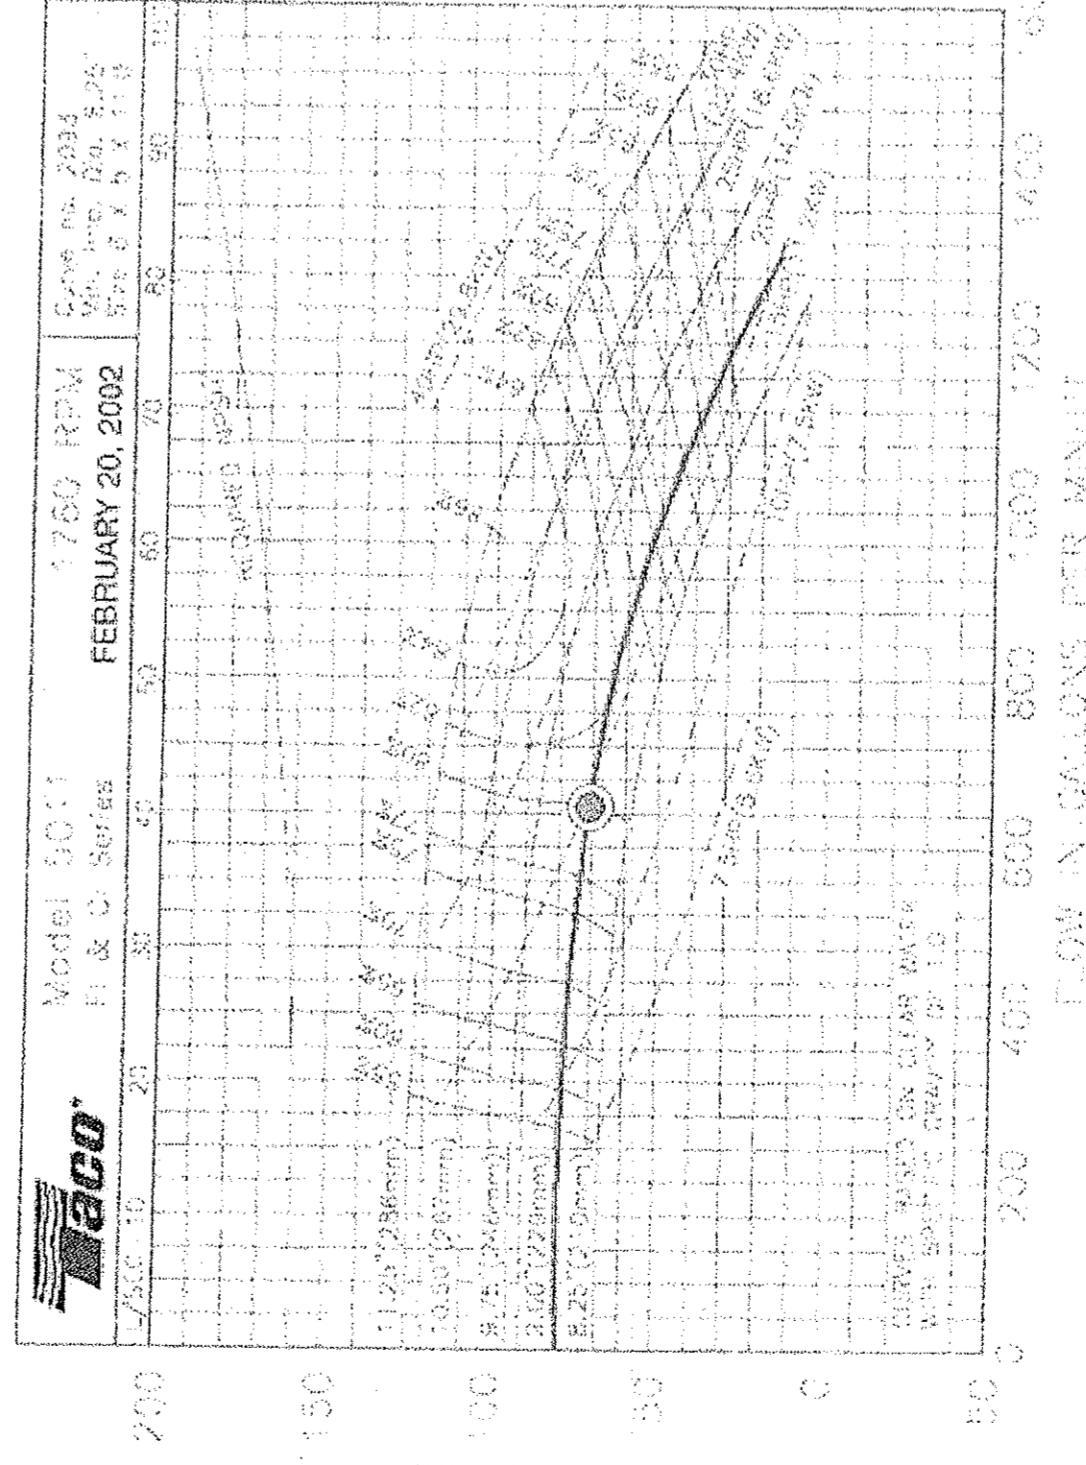


3 CHILLED WATER PUMP CURVE DATA - 1
 NOT TO SCALE

4 CHILLED WATER PUMP CURVE DATA - 2
 NOT TO SCALE

#	REVISION DESCRIPTION	DATE
1 <td></td> <td>11/04/10</td>		11/04/10

CHILLER REPLACEMENT PROJECT
 MHMRA BUILDING, 7011 SW FREEWAY
 HOUSTON, TX

REDDING
 CONSULTING ENGINEERS
 801 TRAVIS, SUITE 2000
 HOUSTON, TEXAS 77002
 PH: 713.237.9800
 FAX: 713.237.9801
 WWW.REDDINGENGINEERS.COM
 Texas Registered Engineering Firm P-3113

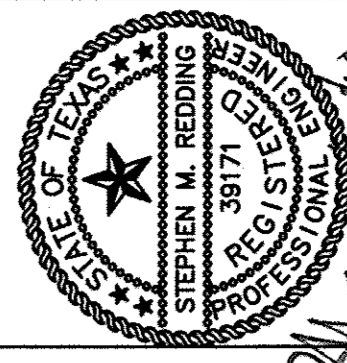

DATE: 11/04/2010
 PROJECT: 10100.00
 SHEET: 1

ME-3.20