



Opening	X	Y	Z	W(Width)	H(Height)
A Damper	2.00	0.00	6.00	36.00	38.00
B Hot water outlet	56.57	73.00	40.81	1.50ins. MPS	-
C Hot water inlet	56.57	73.00	10.16	1.50ins. MPS	-
D Cold water outlet	78.73	73.00	41.69	2.50ins. MPS	-
E Cold water inlet	87.85	73.00	11.31	2.50ins. MPS	-
F Condensate drain conn.	90.00	68.90	7.00	1.25ins. MPS	-
G Hot water outlet	110.57	73.00	40.81	1.50ins. MPS	-
H Hot water inlet	110.57	73.00	10.16	1.50ins. MPS	-
I Fan discharge	161.00	21.29	19.16	19.42	16.68

Dimensions measured from ⊕

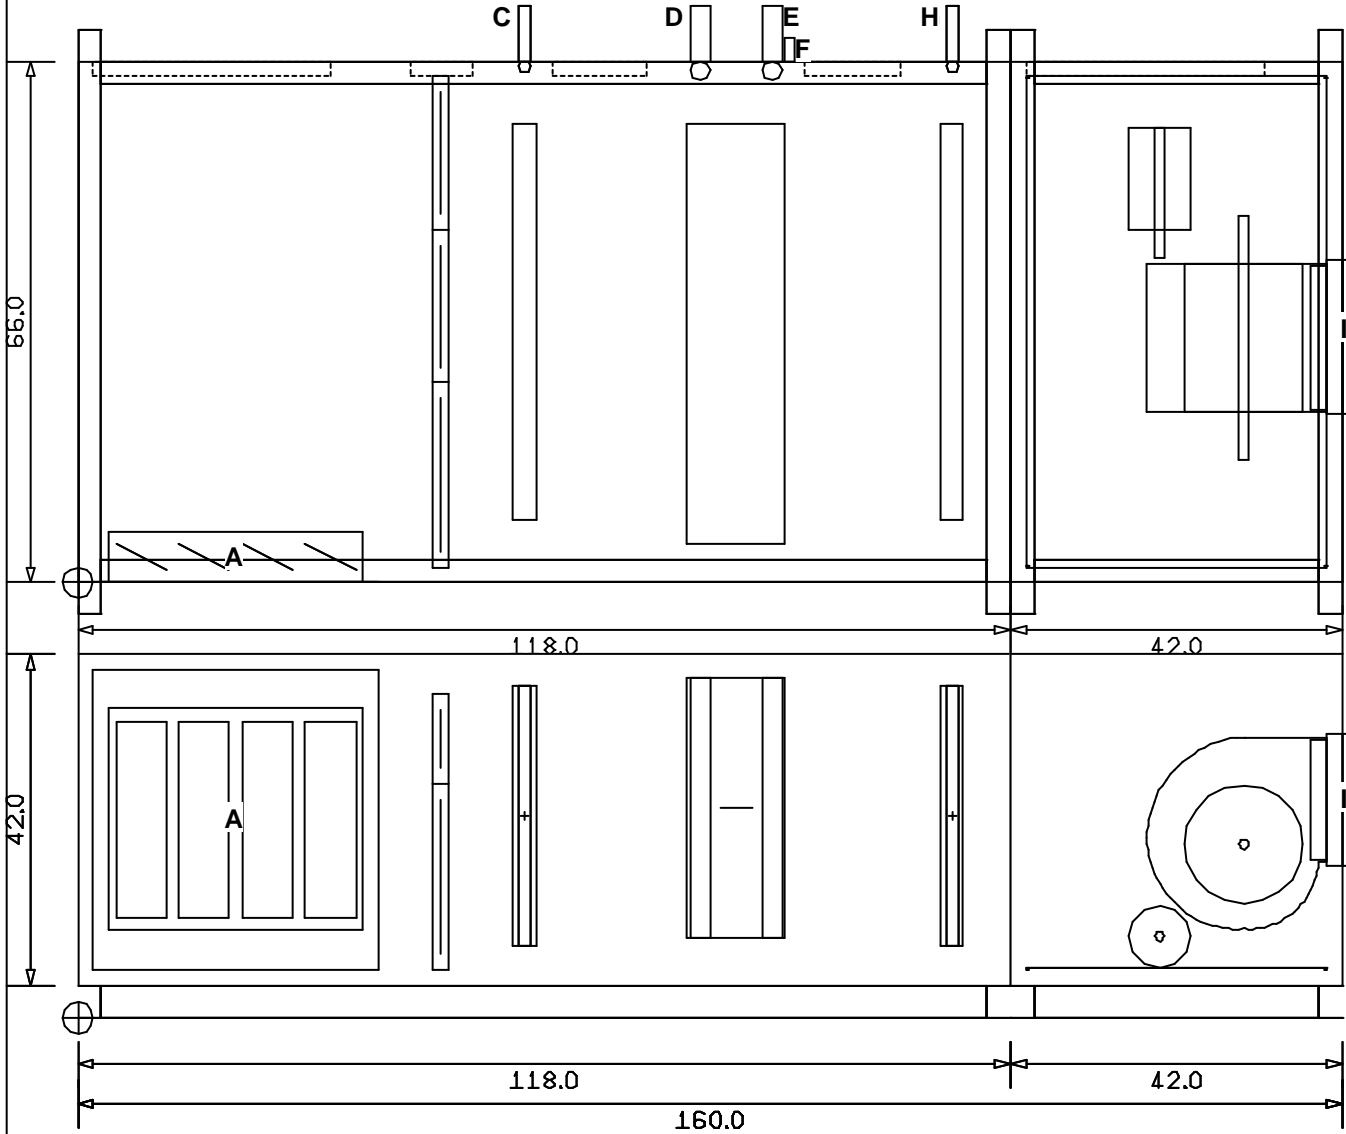


NOTE: Base 4.00ins deep, Cross members extend 4ins on each side of the unit.

VIEW: General Arrangement No Ends
 DRAWN: January-21-2011 (13:10)
 JOB NAME: 7011 SWF Air Handling Units
 UNIT TAGGING: OAHU-1-NW
 MODEL: CAH012GDAC




Opening	X	Y	Z	W(Width)	H(Height)
A Damper	2.00	0.00	6.00	36.00	38.00
B Hot water outlet	56.57	73.00	40.81	1.50ins. MPS	-
C Hot water inlet	56.57	73.00	10.16	1.50ins. MPS	-
D Cold water outlet	78.73	73.00	41.69	2.50ins. MPS	-
E Cold water inlet	87.85	73.00	11.31	2.50ins. MPS	-
F Condensate drain conn.	90.00	68.90	7.00	1.25ins. MPS	-
G Hot water outlet	110.57	73.00	40.81	1.50ins. MPS	-
H Hot water inlet	110.57	73.00	10.16	1.50ins. MPS	-
I Fan discharge	161.00	21.29	19.16	19.42	16.68

Dimensions measured from ⊕

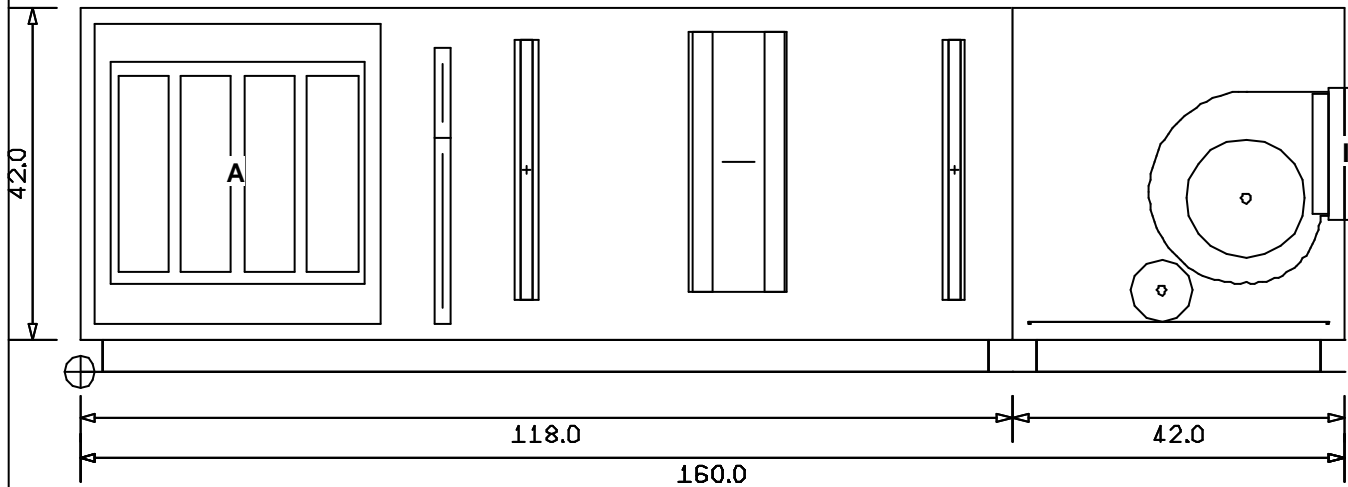


NOTE: Base 4.00ins deep, Cross members extend 4ins on each side of the unit.

VIEW: Right Side
 DRAWN: January-21-2011 (13:10)
 JOB NAME: 7011 SWF Air Handling Units
 UNIT TAGGING: OAHU-1-NW
 MODEL: CAH012GDAC



Opening	X	Y	Z	W(Width)	H(Height)
A Damper	2.00	0.00	6.00	36.00	38.00
B Hot water outlet	56.57	73.00	40.81	1.50ins. MPS	-
C Hot water inlet	56.57	73.00	10.16	1.50ins. MPS	-
D Cold water outlet	78.73	73.00	41.69	2.50ins. MPS	-
E Cold water inlet	87.85	73.00	11.31	2.50ins. MPS	-
F Condensate drain conn.	90.00	68.90	7.00	1.25ins. MPS	-
G Hot water outlet	110.57	73.00	40.81	1.50ins. MPS	-
H Hot water inlet	110.57	73.00	10.16	1.50ins. MPS	-
I Fan discharge	161.00	21.29	19.16	19.42	16.68

Dimensions measured from ⊕

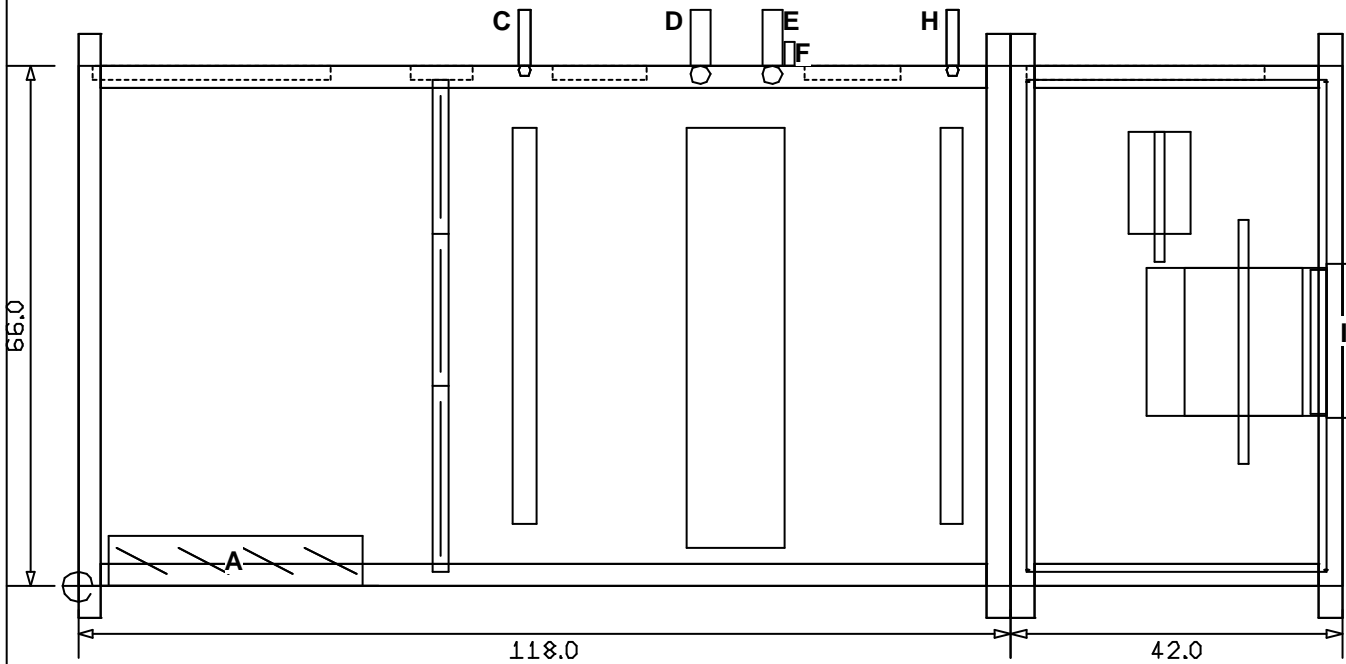

NOTE: Base 4.00ins deep, Cross members extend 4ins on each side of the unit.

VIEW: Top
 DRAWN: January-21-2011 (13:10)
 JOB NAME: 7011 SWF Air Handling Units
 UNIT TAGGING: OAHU-1-NW
 MODEL: CAH012GDAC

