



Opening	X	Y	Z	W(Width)	H(Height)
A Damper	0.00	2.00	18.00	62.00	18.00
B Hot water outlet	30.57	-7.00	42.81	1.50ins. MPS	-
C Hot water inlet	30.57	-7.00	12.16	1.50ins. MPS	-
D Cold water outlet	52.73	-7.00	44.19	1.50ins. MPS	-
E Cold water inlet	61.85	-7.00	12.81	1.50ins. MPS	-
F Condensate drain conn.	64.00	68.90	9.00	1.25ins. MPS	-
G Hot water outlet	84.57	-7.00	42.81	1.50ins. MPS	-
H Hot water inlet	84.57	-7.00 <td 12.16	1.50ins. MPS	-	
I Supply outlet	140.00	2.00	6.00	62.00	12.00

Dimensions measured from ⊕

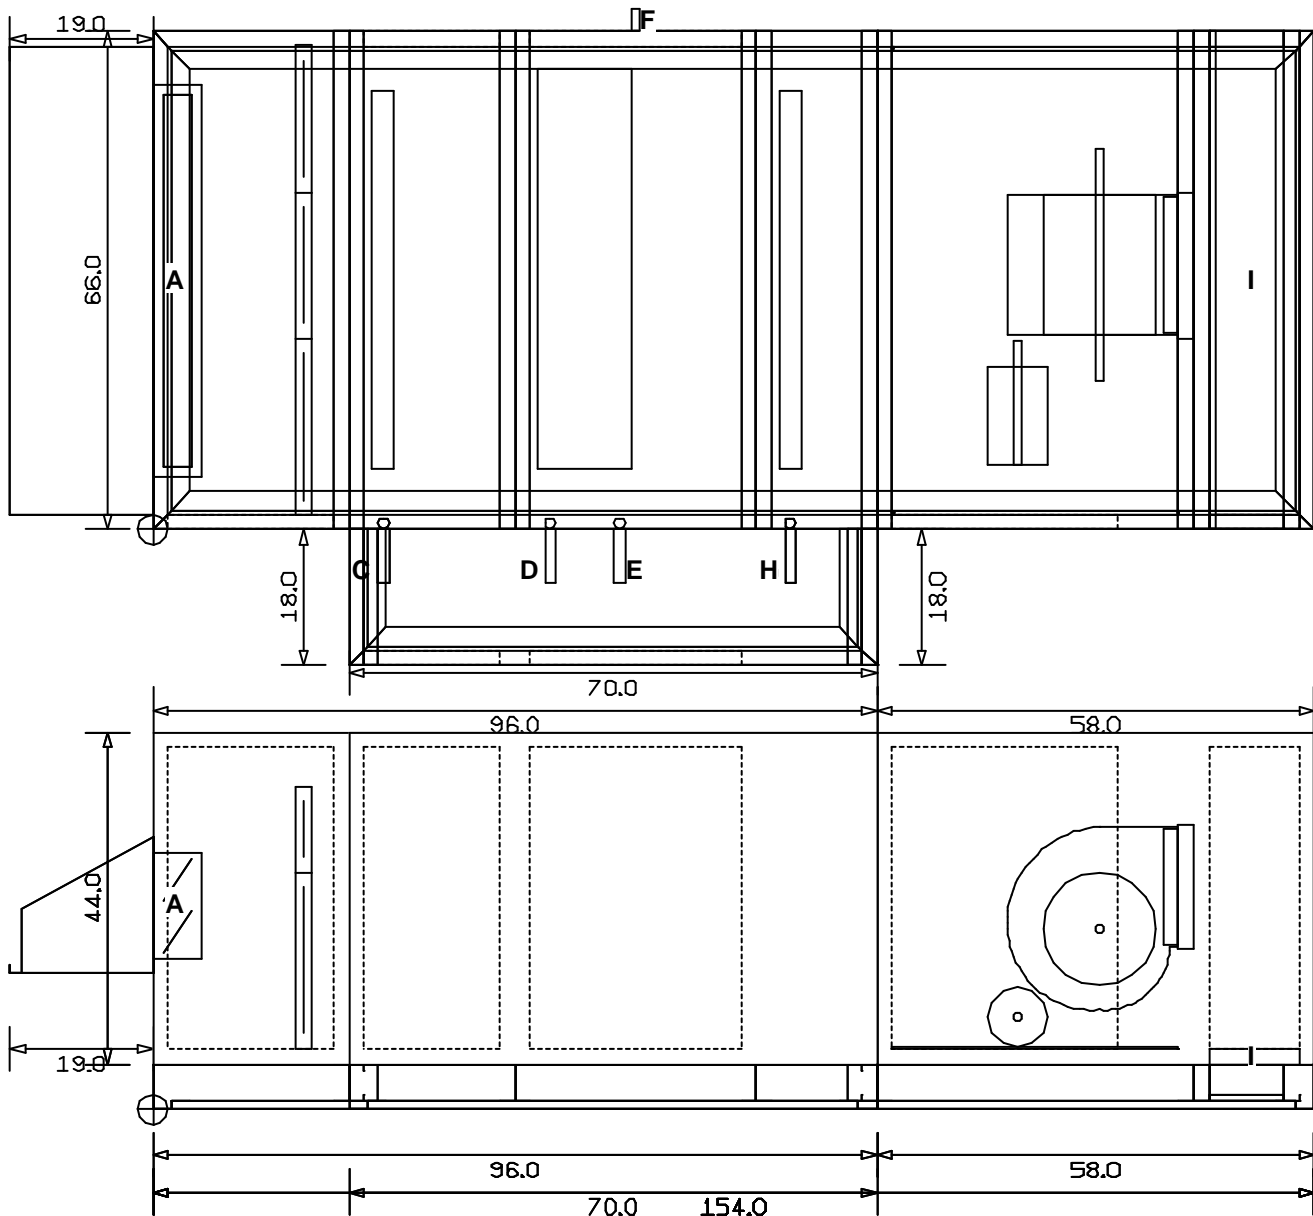


NOTE: Curb Ready Base 6.00ins deep, Lifting Lugs extend 4ins on each side of the unit.
 NOTE: Opening dimensions shown are for unit only, refer to curb drawing for duct opening dimensions.

VIEW: General Arrangement No Ends
 DRAWN: January-21-2011 (13:10)
 JOB NAME: 7011 SWF Air Handling Units
 UNIT TAGGING: OAHU-1-SW
 MODEL: OAH012GDAC




Opening	X	Y	Z	W(Width)	H(Height)
A Damper	0.00	2.00	18.00	62.00	18.00
B Hot water outlet	30.57	-7.00	42.81	1.50ins. MPS	-
C Hot water inlet	30.57	-7.00	12.16	1.50ins. MPS	-
D Cold water outlet	52.73	-7.00	44.19	1.50ins. MPS	-
E Cold water inlet	61.85	-7.00	12.81	1.50ins. MPS	-
F Condensate drain conn.	64.00	68.90	9.00	1.25ins. MPS	-
G Hot water outlet	84.57	-7.00	42.81	1.50ins. MPS	-
H Hot water inlet	84.57	-7.00	12.16	1.50ins. MPS	-
I Supply outlet	140.00	2.00	6.00	62.00	12.00

Dimensions measured from ⊕

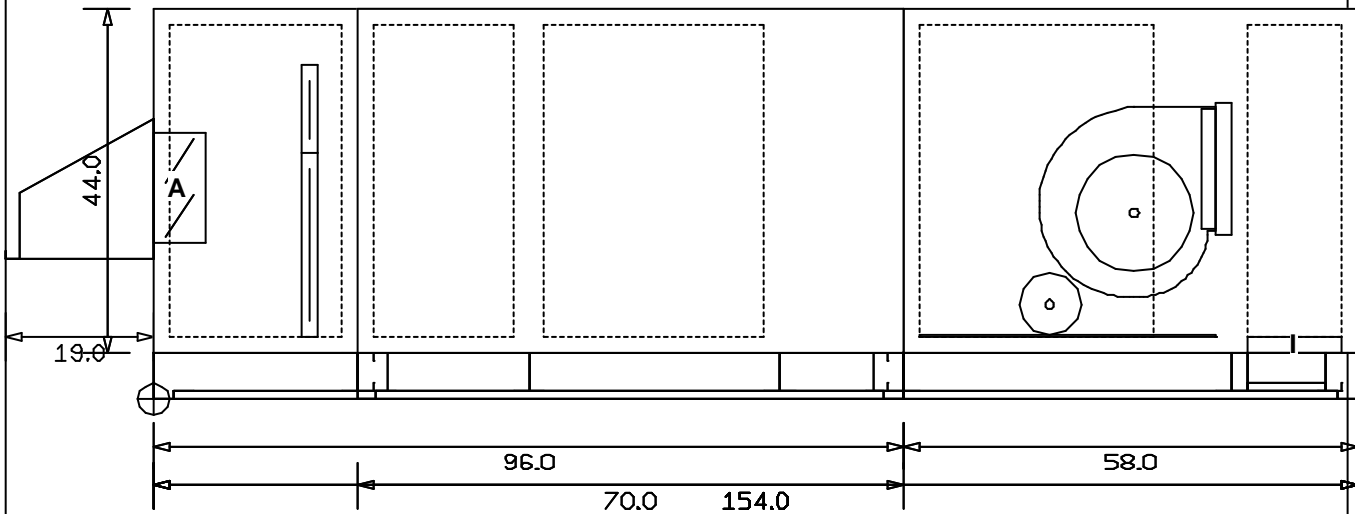


NOTE: Curb Ready Base 6.00ins deep, Lifting Lugs extend 4ins on each side of the unit.
NOTE: Opening dimensions shown are for unit only, refer to curb drawing for duct opening dimensions.

VIEW: Right Side
DRAWN: January-21-2011 (13:10)
JOB NAME: 7011 SWF Air Handling Units
UNIT TAGGING: OAHU-1-SW
MODEL: OAH012GDAC



Opening	X	Y	Z	W(Width)	H(Height)
A Damper	0.00	2.00	18.00	62.00	18.00
B Hot water outlet	30.57	-7.00	42.81	1.50ins. MPS	-
C Hot water inlet	30.57	-7.00	12.16	1.50ins. MPS	-
D Cold water outlet	52.73	-7.00	44.19	1.50ins. MPS	-
E Cold water inlet	61.85	-7.00	12.81	1.50ins. MPS	-
F Condensate drain conn.	64.00	68.90	9.00	1.25ins. MPS	-
G Hot water outlet	84.57	-7.00	42.81	1.50ins. MPS	-
H Hot water inlet	84.57	-7.00 <td 12.16	1.50ins. MPS	-	
I Supply outlet	140.00	2.00	6.00	62.00	12.00

Dimensions measured from ⊕

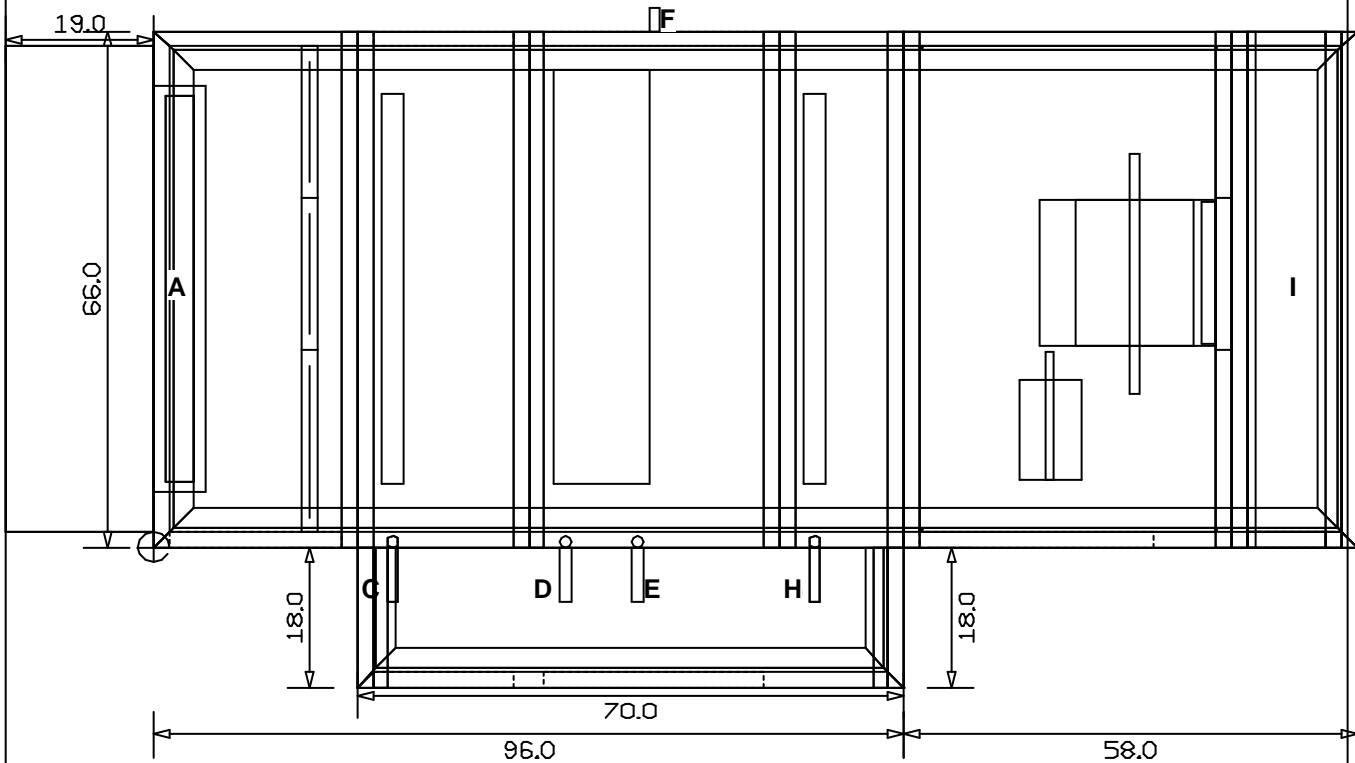

NOTE: Curb Ready Base 6.00ins deep, Lifting Lugs extend 4ins on each side of the unit.
 NOTE: Opening dimensions shown are for unit only, refer to curb drawing for duct opening dimensions.

VIEW: Top
 DRAWN: January-21-2011 (13:10)
 JOB NAME: 7011 SWF Air Handling Units
 UNIT TAGGING: OAHU-1-SW
 MODEL: OAH012GDAC

